# TRANSFORMER PROTECTION SYSTEM

Intuitive protection and advanced communications for power transformers

# **KEY BENEFITS**

Multilin

- Proven and secure high-speed protection system for power transformers
- Integrated transformer thermal monitoring for asset management maintenance optimization
- Improved transformer energization inhibiting
- Ground current supervised sensitive ground fault protection for detection of ground faults down to 5% of the winding limiting the transformer damage
- Assignable CT inputs provide flexibility of usage through all timed and instantaneous over-current protections
- Powerful communication capabilities allowing seamless integration into most communication architectures
- Easy access to information via multiple communication networks including USB, Serial, Fiber or copper Ethernet
- Small footprint easy on new installations or retrofits
- Simplified transformer and protection setup right from the main menu Quick Setup feature. Fast and easy menu navigation
- Draw out and non draw out options available

# **APPLICATIONS**

- Low and medium voltage two winding power transformers
- Reactors and autotransformers

- Applications requiring fast and secure communications
- Harsh environments requiring protection against corrosion and humidity

# **FEATURES**

#### **Protection and Control**

- Dual slope, dual breakpoint characteristic restrained differential
- Second harmonic inrush and fifth harmonic over-excitation inhibits
- Instantaneous differential
- Restricted Ground Fault
- Thermal model
- Neutral Timed and Instantaneous over-current
- Phase and Ground Timed and Instantaneous over-current
- Negative Sequence Timed over-current
- Breaker Failure
- Logic Elements

### Enervista<sup>™</sup> Software

 Enervista Software- an industry-leading suite of software tools that simplifies every aspect of working with Multilin devices

### Metering & Monitoring

- Current Metering
- Event Recorder: 256 events with 1ms time stamping
- Oscillography with 32 samples per cycle and digital states
- IRIG-B clock synchronization
- Security audit trail

### User Interface

- 4X20 character LCD display
- Control panel with 12 LED indicators
- Front USB and rear serial, Ethernet and Fiber ports

 Multiple Protocols: IEC® 61850
 IEC 61850 GOOSE
 MODBUS TCP/IP, MODBUS RTU, DNP 3.0, IEC60870-5-104, IEC60870-5-103



### **Overview**

The 345 is a microprocessor-based system for primary and backup protection of small and medium size distribution transformers. The 345 offers advanced algorithms for automatic magnitude and phase compensations for more than twenty types of two winding transformers, fast and secure biased differential protection with dual slope, and dual breakpoint characteristic. The 345 is equipped with restricted ground fault elements to detect ground faults down to 5% of the transformer winding, basic thermal protection and a full set of phase, ground, neutral and negative sequence over-current protection. The two identical groups with protection elements aim to satisfy these applications, where an automatic change of the settings is required.

The 345 provides excellent accessibility and transparency with regard to the

power system conditions and events, through its target messaging and the four lines of 20 characters display, the Transient and Event Recorders, and the powerful EnerVista PC program.

# Easy to Use

#### **Drawout Construction**

The 345 offers a complete drawout feature eliminating the need for rewiring after testing has been concluded. The withdrawable feature also eradicates the need to disconnect communication cables, and helps retain communication status even after the relay has been withdrawn from its case.

#### **Effortless Retrofit**

The compact and withdrawable feature of the 345 relay minimizes mounting requirements, enables easy retrofit to existing cases, and allows multiple relays to be mounted side by side on a panel. The 345 also provides a pluggable RS485 & IRIG-B connection for easy trouble shooting.

## **Easy to Configure**

#### Fast & Simple Configuration

Providing ease-of-use functionality, the 345 allows for transformer configuration in a simple one page setup screen. Therefore complete transformer protection setup can be completed in one easy step.

## Advanced Communications

# Easy integration into new or existing infrastructure

With several Ethernet and serial port options, and a variety of communication protocols, the 345 provides advanced and flexible communication selections for new and existing applications.

#### **345 Relay Features**



## **Enhanced Diagnostics**

#### **Preventative Maintenance**

The 345 allows users to track relay exposure to extreme environmental conditions by monitoring and alarming at high or low temperatures. This data allows users to proactively schedule regular maintenance work and upgrade activities.

### Failure Alarm

The 345 detects and alarms on communication port and IRIG-B failures. The 345 also enables users to analyze system performance via diagnostics information such as event records and oscillography. It issues detailed transformer health reports and alarms when thresholds are exceeded.

### **Cost Effective**

#### **Robust Design**

The 345 is subjected to Accelerated Life Testing (ALT) to validate accurate relay functions under specified normal conditions. The device is further tested for durability through High Accelerated Life Testing (HALT), undergoing stress testing for extreme operating conditions.

#### **Reduced Life Cycle Cost**

The 345 is designed to reduce total installation and life cycle cost for transformer protection. The draw out construction of the device reduces downtime during maintenance and decreases extra wiring needed for relay testing and commissioning.

#### **Multiple Options**

Several options for protection and communications are provided to match basic to high end application requirements.

### **Protection & Control**

The 345 transformer protection system is designed to protect and control small to medium size power transformers. Flexible and powerful, the 345 provides advanced transformer protection, control and monitoring in one economical drawout design. The 345 contains a full range of self-contained protection and control elements as detailed in the Functional Block Diagram and in the Features table.

#### Percent Differential Protection

The Percent Differential protection is based on a proven algorithm that provides good sensitivity on detecting internal faults and better stability during through-fault conditions. The protection is characterized with the following key elements:

- configurable dual slope, dual breakpoint differential/restraint characteristic
- Inrush inhibiting
- Overexcitation inhibits

#### Dual Slope, Dual Breakpoint Differential / Restraint Characterisitc


This characteristic defines the area of percent differential protection operation versus no-operation, constructed through the setting of the minimum pickup differential current, the settings of slope 1 and slope 2 connected by a cubic spline curve, as well as the settings of breakpoint 1 and breakpoint 2. The maximum winding current is used as a restraining signal for better through-fault stability under CT saturation conditions.

#### Inrush Inhibit

The 2nd harmonic inrush inhibit function is selectable in order to cover energization of different types of transformers, and can be set to either per-phase, 2-out-of-3, or average mode.


#### **Overexcitation inhibit**

An increase in transformer voltage, or decrease in system frequency may result in transformer overexcitation condition. In some cases the transformer overexcitation may result in undesirable operation of the percent differential element. Fifth harmonic inhibiting is integrated into the



The settings for the dual-slope, dual-breakpoint characteristic provides higher flexibility for shaping up the characteristic and achieve better sensitivity and security.



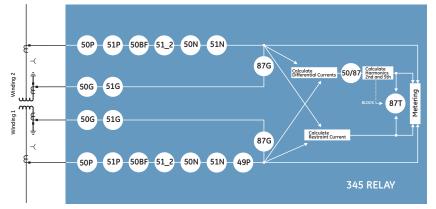

#### ANSI® Device Numbers & Functions

Device Number	Function
49	Thermal Model
50/87	Instantaneous Differential
50G	Ground/Sensitive Ground Instantaneous Overcurrent
50N	Neutral Instantaneous Overcurrent
50P	Phase Instantaneous Overcurrent
50BF	Breaker Failure
51_2	Negative Sequence Timed Overcurrent
51G	Ground/Sensitive Ground Timed Overcurrent
51N	Neutral Timed Overcurrent
51P	Phase Timed Overcurrent
87G	Restricted Ground Fault
87T	Percent Differential

percent differential element to cater such overexcitation conditions.

#### Unrestrained differential

An unrestrained differential element is provided for fast tripping on heavy internal faults to limit further damage to the transformer and minimize the risk to the rest of the system.

### **Restricted Ground Fault (RGF)**

The Restricted Ground Fault (RGF) elements extend the protection coverage to the neutral point of wye-connected windings where fault currents may be below the pickup of the main transformer differential element. The RGF elements use maximum phase winding currents as a restraining signal to provide stability during through fault conditions. Configurable ground current supervision is integrated into the element to add more stability during non-ground out of zone faults with CT saturation, resulting in excessive neutral current, that may be enough to cause RGF operation.

#### Thermal protection

The 345 relay provides basic thermal protection based on winding heating and cooling constants. The protection monitors the winding loading, and is settable to produce alarm or trip, based on the selected overloading criteria.


#### **Overcurrent Elements**

The 345 relay provides phase, neutral, ground and negative sequence overcurrent functions that are configurable with respect to either winding currents. They can run in parallel with the main differential protection, and can be set to provide either primary or backup transformer protection for all types of transformer faults.

When ordered with sensitive ground CTs, the 345 relay can be set to provide 10 times more sensitivity on detection of ground fault currents through the transformer winding neutrals grounded via current limiting resistor.

### Inputs/Outputs

The 345 features the following inputs and outputs for monitoring and control of typical transformer applications:

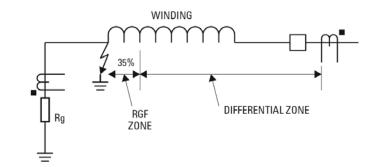

Faults close to the neutral point of a wye-connected winding do not generate adequate fault current for differential element to pick up. Restricted Ground Fault protection provides sensitive ground fault detection for low-magnitude fault currents.

- 10 contact Inputs with programmable thresholds
- 2 Form A output relays for breaker trip with coil monitoring
- 5 Form C output relays

## **Advanced Automation**

#### Logic Elements

The 345 relay has sixteen Logic Elements available for the user to build simple logic using the state of any programmed contact, virtual, or remote input, or an output operand from protection, or control elements.

The logic provides for assigning up to three triggering inputs in an "AND/OR" gate for the logic element operation and up to three blocking inputs in an "AND/OR" gate for defining the block signal. Pickup and dropout timers are available for delaying the logic element operation and reset respectively.

#### Virtual Inputs

Virtual inputs allow communication devices the ability to write digital commands to the 345 relay. These commands could be changing setting groups or blocking protection elements.

#### IEC61850

The 345 supports IEC 61850 Logical Nodes which allows for digital communications to DCS, SCADA and higher level control systems.

In addition, the 345 also supports IEC 61850 GOOSE communication, providing a means of sharing digital point state information between 345's or other IEC61850 compliant IED's.

- Eliminates the need for hardwiring contact inputs to contact outputs via communication messaging.
- Transmits information from one relay to the next in as fast as 8 ms.
- Enables sequence coordination with upstream and downstream devices.
- When Breaker Open operation malfunctions, GOOSE messaging sends a signal to the upstream breaker to trip and clear the fault.

### **Monitoring & Diagnostics**

#### **Event Recording**

Events consist of a broad range of change of state occurrences, including pickups, trips, contact operations, alarms and self test status. The 345 stores up to 256 events time tagged to the nearest millisecond. This provides the information required to determine sequence of events which facilitates diagnosis of relay operation. Each event is individually maskable in order to avoid the generation of undesired events, and includes the values of currents and status of all the protection elements at the moment of the event.

#### Oscillography

The 345 captures current waveforms and digital channels at 32 samples per cycle. The oscillography record captures 8 individual analog channels allowing for detailed analysis. The oscillography is triggered either by internal signals or an external contact.

#### IRIG-B

IRIG-B is a standard time code format that allows time stamping of events to be synchronized among connected devices within 1 milliseconds. An IRIG-B input is provided in the 345 to allow time synchronization using a GPS clock over a wide area. The 345 IRIG-B supports both AM and DC time synchronization with an auto detect feature that removes the requirement for manual selection.

### Metering

The 345 continuously measures and computes the following AC signals indicating the health of the protected transformer:

- Phase winding currents
- Winding ground current
- Winding neutral current
- Winding negative sequence current
- Differential and restraint currents perphase
- Winding ground differential current
- Percent 2nd and 5th harmonics differential currents per phase
- · Percent thermal capacity per-phase

The states of all digital inputs/outputs are provided through the actual values either from the summary pages or individually. This includes:

- States of contact inputs
- States of virtual inputs
- States of remote inputs
- States of relay outputs
- States of logic elements

### Security

#### Security Audit Trail

The Security Audit Trail feature provides complete traceability of relay setting changes at any given time and is NERC CIP compliant. The 345 maintains a history of the last changes made to the 345 configuration, including modifications to settings and firmware upgrades. Security Setting Reports include the following information:

- If Password was required to change settings
- MAC address of user making setting changes
- Listing of modified changes
- Method of setting changes Keypad, Front serial port, Ethernet, etc.


#### Password Control

With the implementation of the Password Security feature in the 345 relay, extra measures have been taken to ensure unauthorized changes are not made to the relay. When password security is enabled, changing of setpoints or issuing of commands will require passwords to be entered. Separate passwords are supported for remote and local operators, and separate access levels support changing of setpoints or sending commands.

## Advanced Communications

The 345 utilizes the most advanced communication technologies today making it the easiest and most flexible transformer protection relay to use and integrate into new and existing infrastructures. Multiple communication ports and protocols allow control and easy access to information from the 345.

The 345 supports the most popular industry standard protocols enabling easy, direct integration into electrical SCADA and HMI systems. Modbus RTU is provided as standard with a RS485 networking port.

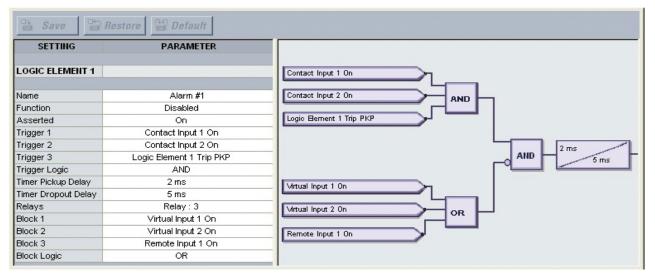

Eight logic elements available for simple logic for applications such as manual control, interlocking, and peer to peer tripping.

The following optional protocols are available:

- IEC 61850
- IEC 61850 GOOSE
- DNP 3.0,
- Modbus RTU,
- Modbus TCP/IP,
- IEC 60870-5-104,
- IEC 60870-5-103

## Easy to Use

#### Simplified Transformer Setting

Included with every 345 Transformer Protection System is the Multilin Simplified Transformer Setup. The Simplified Transformer Setup provides users with a quick and easy method to setup and start the transformer and process in applications that require fast commissioning.

The Simplified Transformer Setup will generate a complete 345 setting file based on the transformer nameplate and system information entered by the user. Once all the information is entered, the Simplified Transformer Setup will generate the settings file, as well as provide the documentation indicating which settings were enabled, along with an explanation of the specific parameters entered. The Simplified Transformer Setup will provide a detailed setting file in PDF format that can be saved or printed for future reference.

## **Enervista Software**

The Enervista suite is an industry leading set of software programs that simplifies every aspect of using the 345 relay. The Enervista suite provides all the tools to monitor the status of the protected asset, maintain the relay, and integrate the information measured into DCS or SCADA monitoring systems. Convenient COMTRADE and sequence of event viewers are an integral part of the 345 set up software and are included to ensure proper protection and system operation.

#### Launchpad

Enervista Launchpad is a powerful software package that provides users with all of the set up and support tools needed for configuring and maintaining GE products. The setup software within Launchpad allows configuring devices in real time by communicating using serial, Ethernet or modem connections, or offline by creating setting files to be sent to devices at a later time.

Included in Launchpad is a document archiving and management system that ensures critical documentation is up-to-date and available when needed. Documents made available include:

- Manuals
- Application Notes
- Guideform Specifications
- Brochures
- Wiring Diagrams
- FAQs
- Service Bulletins

#### **Viewpoint Monitoring**

Viewpoint Monitoring is a simple to use and full featured monitoring and data recording software package for small systems. Viewpoint monitoring provides a complete HMI package with the following functionality:

- Plug and play device monitoring
- System single line monitoring and control
- Annunciator alarm screens
- Trending reports
- Automatic event retrieval
- Automatic waveform retrieval

#### **Viewpoint Maintenance**

Viewpoint Maintenance provides tools that will increase the security of the 345 Transformer Protection System. Viewpoint Maintenance will create reports on the operating status of the relay, and simplify the steps to troubleshoot protected transformers.

		5	SECU	RITY/	CHANGE H	ISTO	ry Ri	PORT		
								Generated at: \$	September 15 2010 16:5	6:05
	Summary									1
Device Na				345					LAINER	I
Device Ty				SR 345						
Order Co					5HSMNN2EDN					1
Firmware				1.30						1
Serial Nu				BL0A0900						
Communi	cation:			COM 3, 1	15200					
Setting	g Changes	History								
Session#		Method of	# Of	Password	Changes by Whom	Even	t Type	Filename	Status	Firm.
	Change	Change		Entered	IP /Mac					Version
1	09/15/2010	USB	0	Yes	0:0:0:0	Setpo	int File		Relay Ready	130
	06:23:20 PM									
2	09/15/2010 06:24:52 PM	USB	14	Yes	3:13:81:141	Setpoin	t Change	345_130.sr3 : C:	Relay Ready	130
	00:24:02 PM							6:		
Setting	g Changes	Detail His	story							
Session#	Date Of Cha	nge	Old Value	2	New Value	;		Data Item	Modbus Ad	dress
2	09/15/201		50		5		W1 Ser	sitive Ground	CT 0Xe49	
2	06:24:52 P		50		5		W2 6	Primary sitive Ground	CT 0Xe4a	
<b>`</b>	06:24:52 P		50		5		12 301	Primary	01 07044	
2	09/15/201		5		5000		W1 P	hase CT Primai	ry 0Xe4b	
2	06:24:52 P		5		5000		W2 PI	ase CT Prima	rv 0Xe4d	
-	06:24:52 P		5		5000				.,	
2	09/15/201		0		1		Sup	ply Frequency	0X11b	
2	06:24:58 P		0		1		Phase	e Compensatio	n 0X58e	
· ·	06:25:13 P		•		· ·		1 1100	o o mpensario		
2	09/15/201 06:25:18 P		0		1		Wind	ng 2 Groundin	g 0X594	
2	09/15/201		0		69		Brea	ker Connected	1 0X56b	
	06:29:39 P	M	-							
2	09/15/201 06:29:39 P		0		64		Brea	ker 52a Contac	t 0X56c	
2	09/15/201		0		65		Brea	ker 52b Contac	t 0X56d	
	06:29:39 P	M								
2	09/15/201 06:29:49 P		0		70		Break	er 2 Connecte	d 0X585	
_	00:23:49 P	-								
0.0							1/100			
る	GE Mult	tilin			Ener	ista	VIEV	VPUINT	maintenar	nce
-										

Trace any setting changes with security audit trail

The tools available in Viewpoint Maintenance include:

- Settings Security Audit Trail
- Device Health Report
- Comprehensive Fault Diagnostics


#### **EnerVista Integrator**

EnerVista Integrator is a toolkit that allows seamless integration of Multilin devices into new or existing automation systems. Included in the EnerVista Integrator is:

- OPC/DDE Server
- Multilin Devices
- Automatic Event Retrieval
- Automatic Waveform Retrieval

### **Power System Troubleshooting**

Analyze power system disturbances with transient fault recorder and event records

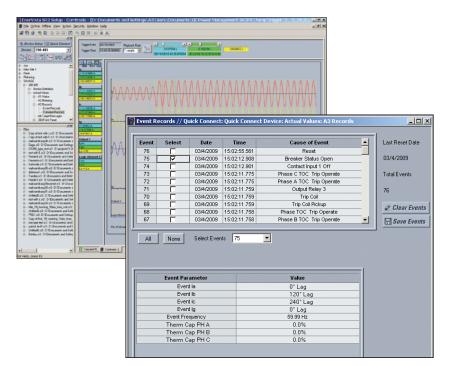

### **User Interface**



IN SERVICE: This indicator will be on continuously lit if the relay is functioning normally and no major self-test errors have been detected.

TROUBLE: Trouble indicator LED will be AMBER if there is a problem with the relay or the relay is not configured.

TRIP: Indicates that the relay has tripped the transformer offline based on predefined programmed conditions.

ALARM: Indicates that the transformer is currently operating in an alarm condition and may proceed to a trip condition if not addressed.

MAINTENANCE: Environmental alarms such as ambient temperature alarm or coil monitor alarms.

The display messages are organized into Main Menus, Pages, and Sub-pages.

There are four main menus labeled Actual Values, Quick Setup, Setpoints, and Maintenance. Pressing the MENU key followed by the MESSAGE key scrolls through the four Main Menu Headers.

The ten button keypad allows users easy access to relay configuration and information.


USER INTERFACE OPTIONS: Draw out and non draw out options available


# Dimensions


		V-OUT SIGN	NON DRAW-OUT DESIGN		
	in	mm	in	mm	
н	7.93	201.5	7.98	202.7	
W	6.62	168.2	6.23	158.2	
D	9.62	244.2	9.35	237.5	
W1	3.96	100.6	3.96	100.6	
D1	7.89	200.4	7.88	200.2	
D2	1.73	43.8	1.47	37.3	
Η1	6.82	173.2	6.82	173.2	


F

Rear









# **Technical Specifications**

PASSWORD SECUR	
Master Reset Password:	8 to 10 alpha-numeric characters
Settings Password: Control Password:	3 to 10 alpha-numeric characters for local or remote access 3 to 10 alpha-numeric characters
control Fussword.	for local or remote access
	for local of remote access
	GROUND/NEGATIVE SEQUENCE TIMED
OVERCURRENT (51	P/51N/51G/51 2)
Ground Current:	Fundamental
Pickup Level:	0.04 to 20.00 x CT in steps of 0.01 x CT
Dropout Level:	97 to 99% of Pickup @ I > 1 x CT
	pickup - 0.02 x CT @ I > 1 x CT
Curve Shape:	ANSI Extremely/Very/Moderately/
	Normally Inverse Definite Time (1 s base curve)
	IEC Curve A/B/C/Short
	IAC Extremely/Very/Inverse/Short
Curve Multiplier:	0.05 to 20.00 in steps of 0.01
Reset Time:	Instantaneous, Linear
Time Delay	±3% of expected inverse time or 1
Accuracy:	cycle, whichever is greater
Level Accuracy:	per CT input
	D TIMED OVERCURRENT (51SG)
Ground Current:	Fundamental
Pickup Level:	0.005 to 3.000 x CT in steps of 0.001
Dranout Loual:	x CT
Dropout Level:	97 to 99% of Pickup @ I > 0.1 x CT pickup - 0.02 x CT @ I > 0.1 x CT
Curve Shape:	ANSI Extremely/Very/Moderately/
cuive snupe.	Normally Inverse
	Definite Time (1 s base curve)
	IEC Curve A/B/C/Short
	IAC Extremely/Very/Inverse/Short
Curve Multiplier:	0.5 to 20.0 in steps of 0.1
Reset Time:	Instantaneous, Linear
Time Delay	±3% of expected inverse time or 1
Accuracy:	cycle, whichever is greater
Level Accuracy:	per CT input

	GROUND/NEGATIVE SEQUENCE
INSTANTANEOUS (	OVERCURRENT (50P/50Ň/50G/50_2)
Current:	Fundamental
Pickup Level	0.05 to 20.00 x CT in steps of 0.01 x CT
Dropout Level:	97 to 99% of Pickup I > 0.1 x CT
	Pickup - 0.02 x CT at I < 0.1 x CT
Time delay:	0.00 to 300.00 sec in steps of 0.01
Operate Time:	<30 ms @ 60Hz (I > 2.0 x PKP, No time
	delay)
	<35 ms @ 50Hz (I > 2.0 x PKP, No time
	delay)
Time Delay	0 to 1 cycle (time delay selected)
Accuracy:	
Level Accuracy:	per CT input

ANSFORMER 'T)	PERCENT DIFFERENTIAL PROTECTION
ferential/ straint aracteristic:	Dual Slope, Dual Breakpoint
nimum Pickup vel:	
pe 1 Range: pe 2 Range: eepoint 1: eepoint 2: Harmonic hibit Level:	15 to 100% in steps of 1% 50 to 100% in steps of 1% 0.50 to 4.00 × CT in steps of 0.01 1.00 to 10.00 × CT in steps of 0.01 1.0 to 40.0% insteps of 0.1%
Harmonic nibit Mode:	Per-phase, 2-out-of-three, Average
Harmonic nibit Level:	1.0 to 40.0% insteps of 0.1%
opout Level: erate Time:	97 to 98% of Pickup < 20 ms (no harmonics inhibits selected) < 30 ms (harmonics inhibits selected)
vel Accuracy:	per current inputs

	ERMAL PROTECTION (49)
Current: Pickup Accuracy: Timing Accuracy:	Fundamental per current inputs ±3% of expected time, or 30 ms (whichever is greater) @ I > 1.5 x PKP
SENSITIVE GROUP (50SG)	ND INSTANTANEOUS OVERCURRENT
Pickup Level (Gnd IOC):	0.005 to 3.000 x CT in steps of 0.001 x CT
Dropout Level:	97 to 99% of Pickup @ I > 0.1 x CT Pickup - 0.002 x CT @ I < 0.1 x CT
Time delay:	0.00 to 300.00 sec in steps of 0.01 <30 ms @ 60Hz (I > 2.0 x PKP. No time
Operate Time:	<30 ms @ 60Hz (I > 2.0 x PKP, No time delay) <35 ms @ 50Hz (I > 2.0 x PKP, No time delay)
Time Delay Accuracy:	0 to 1 cycle (time delay selected)
Level Accuracy:	per CT input
TRANSFORMER INS PROTECTION (50/8	TANTANEOUS DIFFERENTIAL 7)
Pickup Level: Dropout Level: Operate Time: Level Accuracy:	3.00 to 20.00xCT in steps of 0.01xCT 97 to 98% of Pickup <30 ms per current inputs

RESTRICTED GROU	ND FAULT (87G)
Number of	2
Elements:	
Pickup Level:	0.02 to 20.00 xCT in steps of 0.01
	0.002 to 2.000 xCT (with sensitive CTs)
GND Supervision	0.02 to 20.00 xCT in steps of 0.01
Level:	0.002 to 2.000 xCT (with sensitive CTs)
Dropout Level:	97 to 98% of Pickup
Slope Range:	0 to 100% in steps of 1
Pickup Delay:	0.00 to 600.0 s in steps of 0.01
Operate Time:	< 30 ms @ 0 ms time delay
Level Accuracy:	per current inputs
,	

# **Technical Specifications (Continued)**

PHASE & GROUND ( CT Primary:	1 to 6000 A
Range:	0.02 to 20 × CT 1 A or 5 A (must be specified with
Input type:	order P1G1 or P5G5)
	Configurable 1 A or 5 A (must be specified with order POGO)
Nominal	50/60 Hz
frequency: Burden:	<0.1 VA at rated load
Accuracy:	±1% of reading at 1× CT
	±3% of reading from 0.1 to 20 × CT ±20% of reading from 0.02 to 0.09
CT with stored	× CT
CT withstand:	1 second at 100 × rated current 2 seconds at 40 × rated current
	continuous at 3 × rated current
SENSITIVE GROUND	CURRENT INPUT
CT Primary: Range:	1 to 600 A 0.002 to 3 × CT
Input type:	1 A or 5 A (must be specified with order P1S1 or P5S5)
Nominal	50/60 Hz
frequency:	+1% of roading at 1x CT
Accuracy:	±1% of reading at 1× CT ±3% of reading from 0.01 to 3 × CT
	±20% of reading from 0.002 to 0.009 × CT
CT withstand:	1 second at 100 × rated current
	2 seconds at 40 × rated current continuous at 3 × rated current
TOANGUENT	
TRANSIENT RECORI Buffer size:	3 s
No. of buffers: No. of channels:	1×192, 3×64, 6×32 14
Sampling rate:	32 samples per cycle
Triggers:	Manual Command Contact Input
	Virtual Input
	Logic Element Element Pickup/Trip/Dropout/Alarm
Data:	AC input channels
	Contact input state Contact output state
	Virtual input state
Data storage:	Logic element state RAM - battery backed-up; retained
5	for 3 days
EVENT RECORDER	256
EVENT RECORDER Number of events: Header:	256 relay name, order code, firmware
Number of events: Header:	relay name, order code, firmware revision
Number of events:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase
Number of events: Header:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive
Number of events: Header:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current,
Number of events: Header:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral
Number of events: Header:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restroint current, per-phase differential current,
Number of events: Header:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal
Number of events: Header: Content:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity
Number of events: Header:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal
Number of events: Header: Content: Data Storage: CLOCK	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restroint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days
Number of events: Header: Content: Data Storage:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time)
Number of events: Header: Content: Data Storage: CLOCK	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutrol current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude
Number of events: Header: Content: Data Storage: CLOCK Setup:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Madulated) Amplitude modulated: 1 to 10 V pk-pk
Number of events: Header: Content: Data Storage: CLOCK Setup:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC
Number of events: Header: Content: Data Storage: CLOCK Setup:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Madulated) Amplitude modulated: 1to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 k0hm ± 10% RIC Accuracy: ± 1 min / month at
Number of events: Header: Content: Data Storage: CLOCK Setup:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10%
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: LOGIC ELEMENTS	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutrol current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Madulated) Amplitude modulated: 1to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 k0hm ± 10% RIC Accuracy: ± 1 min / month at
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: Number of logic elements: Trigger source	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutrol current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: Number of logic elements:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restroint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kohm ± 10% RTC Accuracy: ± 1 min / month at 25°C
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: Number of logic elements: Trigger source inputs per element: Block inputs per	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restroint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kohm ± 10% RTC Accuracy: ± 1 min / month at 25°C
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: IRIG-B: <u>LOGIC ELEMENTS</u> Number of logic elements: Trigger source inputs per element: Block inputs per element: Supported	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: Number of logic elements: Trigger source inputs per element: Block inputs per element: Supported operations:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, ner-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: IRIG-B: <u>LOGIC ELEMENTS</u> Number of logic elements: Trigger source inputs per element: Block inputs per element: Supported	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restroint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C 16 3 AND, OR, NOT, Pickup / Dropout timers 0 to 6000 ms in steps of 1 ms 0 to 6000 ms in steps of 1 ms
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: Number of logic elements: Trigger source inputs per element: Block inputs per element: Supported operations: Pickup timer: Dropout timer: BREAKER FAILURE ( Pickup Level:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C 16 3 AND, OR, NOT, Pickup / Dropout timers 0 to 6000 ms in steps of 1 ms 0 to 6000 ms in steps of 1 ms 0 to 5020.00 × CT in steps of 0.01
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: IRIG-B: IRIG-B: IRIG-B: Support of logic elements: Block inputs per element: Block inputs per element: Block inputs per element: Dropout timer: Dropout timer: Dropout tevel: Dropout Level:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 k0hm ± 10% RTC Accuracy: ± 1 min / month at 25°C 16 3 AND, OR, NOT, Pickup / Dropout timers 0 to 6000 ms in steps of 1 ms 0 to 6000 ms in steps of 0.01 97 to 98% of pickup
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restroint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C 16 3 AND, OR, NOT, Pickup / Dropout timers 0 to 6000 ms in steps of 1 ms 0 to 6000 ms in steps of 0.01 97 to 98% of pickup 0.03 to 1.00 s in steps of 0.01 s 0.00 to 1.00 s in steps of 0.01 s
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: IRIG-B: Number of logic elements: Trigger source inputs per element: Block inputs per element: Block inputs per element: Dropout timer: Dropout timer: Dropout tevel: Timer 1 Delay:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restraint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - bottery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C 16 3 3 AND, OR, NOT, Pickup / Dropout timers 0 to 6000 ms in steps of 1 ms 0 to 6000 ms in steps of 1 ms 0.05 to 20.00 x CT in steps of 0.01 97 to 98% of pickup 0.03 to 1.00 s in steps of 0.01 s
Number of events: Header: Content: Data Storage: CLOCK Setup: IRIG-B: IRIG-B: IRIG-B: IRIG-B: Under of logic elements: Trigger source inputs per element: Block inputs per element: Supported operations: Pickup timer: Dropout timer: BREAKER FAILURE ( Pickup Level: Dropout tevel: Timer 2 Delay: Time 2 Delay:	relay name, order code, firmware revision event number, date of event, cause of event, per-phase current, ground current, sensitive ground current, neutral current, ground differential current, negative sequence current, restroint current, per-phase differential current, per-phase differential second harmonic current, thermal capacity RAM - battery backed up; retained for 3 days Date and time (Daylight Savings Time) Auto-detect (DC shift or Amplitude Modulated) Amplitude modulated: 1 to 10 V pk-pk DC shift: 1 to 10 V DC Input impedance: 40 kOhm ± 10% RTC Accuracy: ± 1 min / month at 25°C 16 3 AND, OR, NOT, Pickup / Dropout timers 0 to 6000 ms in steps of 1 ms 0 to 6000 ms in steps of 0.01 97 to 98% of pickup 0.03 to 1.00 s in steps of 0.01 s 0.00 to 1.00 s in steps of 0.01 s

AMBIENT TEMPERA	
High Temperature Pickup:	20°C to 80°C in steps of 1°C
Low Temperature Pickup:	-40°C to 20°C in steps of 1°C
Time Delay: Temperature	1 to 60 min in steps of 1 min Configurable 90 to 98% of pickup
Dropout: Temperature Accuracy:	±10°C
Timing Accuracy:	±1 second
CONTACT INPUTS	
Inputs: Selectable thresholds:	10 17, 33, 84, 166 VDC
Recognition time: Continuous current draw:	1/2 cycle 2 mA (to be confirmed)
Debounce time:	1 to 64 ms, selectable, in steps of 1 ms
Type: External switch: Maximum input voltage:	opto-isolated inputs wet contact 300 VDC
FORM-A RELAYS	
Configuration: Contact material: Operate time: Continuous current:	2 (two) electromechanical silver-alloy <8 ms 10 A
Make and carry for 0.2s:	30 A per ANSI C37.90
Break (DC inductive, L/R=40 ms):	24 V / 1 A 48 V / 0.5 A 125 V / 0.3 A 250 V / 0.2 A
Break (DC resistive):	24 V / 10 A 48 V / 6 A 125 V / 0.5 A 250 V / 0.3 A
Break (AC inductive): Break (AC resistive):	720 VA @ 250 VAC Pilot duty A300 277 VAC / 10 A

 FORM-A VOLTAGE MONITOR

 Applicable voltage:
 20 to 250 VDC

 Trickle current:
 1 to 2.5 mA

FORM-C RELAYS	
Configuration:	5 (five) electromechanical
Contact material:	silver-alloy
Operate time:	<8 ms
Continuous	10 A
current:	
Make and carry	30 A per ANSI C37.90
for 0.2s:	
Break (DC	24 V / 1 A
inductive, L/R=40	48 V / 0.5 A
ms):	125 V / 0.3 A
	250 V / 0.2 A
Break (DC	24 V / 10 A
resistive):	48 V / 6 A
	125 V / 0.5 A
Devel (AC	250 V / 0.3 A
Break (AC	720 VA @ 250 VAC Pilot duty A300
inductive):	0777140/404
Break (AC	277 VAC / 10 A
resistive):	

### TRIP SEAL-IN Relay 1 trip seal-in: 0.00 to 9.99 s in steps of 0.01 Relay 2 trip seal-in: 0.00 to 9.99 s in steps of 0.01

Keluy z trip seul-in.	0.00 10 5.55 5 11 510 55 61 0.01
<b>HIGH-RANGE POWE</b>	R SUPPLY
Nominal:	120 to 240 VAC
Damas	125 to 250 VDC 60 to 300 VAC (50 and 60 Hz)
Range:	84 to 250 VDC
Ride-through time:	
LOW-RANGE POWE	
Nominal:	24 to 48 VDC
Range:	20 to 60 VDC
5	
ALL POWER SUPPLY	RANGES
	2 × highest nominal voltage for 10
	2 × highest nominal voltage for 10 ms
Voltage withstand: Power	2 × highest nominal voltage for 10 ms 15 W nominal, 20 W maximum
Voltage withstand:	2 × highest nominal voltage for 10 ms
Voltage withstand: Power consumption:	2 × highest nominal voltage for 10 ms 15 W nominal, 20 W maximum 20 VA nominal, 28 VA maximum
Voltage withstand: Power consumption: ETHERNET (COPPER	2 x highest nominal voltage for 10 ms 15 W nominal, 20 W maximum 20 VA nominal, 28 VA maximum
Voltage withstand: Power consumption: ETHERNET (COPPER Modes:	2 × highest nominal voltage for 10 ms 15 W nominal, 20 W maximum 20 VA nominal, 28 VA maximum 10/100 MB (auto-detect)
Voltage withstand: Power consumption: ETHERNET (COPPER	2 × highest nominal voltage for 10 ms 15 W nominal, 20 W maximum 20 VA nominal, 28 VA maximum 10/100 MB (auto-detect) RJ-45
Voltage withstand: Power consumption: ETHERNET (COPPER Modes:	2 × highest nominal voltage for 10 ms 15 W nominal, 20 W maximum 20 VA nominal, 28 VA maximum 10/100 MB (auto-detect)
Voltage withstand: Power consumption: ETHERNET (COPPER Modes: Connector:	2 × highest nominal voltage for 10 ms 15 W nominal, 20 W maximum 20 VA nominal, 28 VA maximum 10/100 MB (auto-detect) RJ-45

ETHERNET (FIBER)	
Fiber type: Wavelength: Connector: Transmit power: Receiver	100 MB Multi-mode 1300 nm MTRJ -20 dBm -31 dBm
sensitivity: Power budget: Maximum input power:	9 dB -11.8 dBm
Typical distance: Duplex: Protocol:	2 km (1.25 miles) half/full Modbus TCP/IP, DNP 3.0, IEC 60870 5-104, IEC 61850 GOOSE
SERIAL	
RS485 port: Baud rates: Response time: Parity: Protocol:	Opto-coupled up to 115 kbps 1 ms typical None, Odd, Even Modbus RTU, DNP 3.0, 1 60870-5-103

JENIAL				
RS485 port:	Opto-coupled			
Baud rates:	up to 115 kbps			
Response time:	1 ms typical			
Parity:	None, Odd, Even			
Protocol:	Modbus RTU, 60870-5-103	DNP	3.0,	IEC
Maximum distance:	1200 m (4000 ft)			
Isolation:	2 kV			

#### USB Standard specification: Connector: Compliant with USB 2.0 115 kbps

TYPE TESTS		
Dielectric voltage		2.3KV
withstand:		
Impulse voltage withstand:	EN60255-5	5KV
Damped	IEC61000-4-	2.5KV CM, 1KV
Oscillatory:	18IEC60255-22-1	DM
Electrostatic	EN61000-4-2/	Level 4
Discharge:	IEC60255-22-2	
RF immunity:	EN61000-4-3/	Level 3
	IEC60255-22-3	
Fast Transient	EN61000-4-4/	Class A and B
Disturbance:	IEC60255-22-4	
Surge Immunity:	EN61000-4-5/	Level 3 & 4
	IEC60255-22-5	
Conducted RF	EN61000-4-6/	Level 3
Immunity:	IEC60255-22-6	
Power Frequency	EN61000-4-7/	Class A & B
Immunity:	IEC60255-22-7	
Voltage	IEC60255-11	15% ripple,
interruptionand		200ms
Ripple DC:		interupts
Radiated &	CISPR11 /CISPR22/	Class A
Conducted: Emissions	IEC60255-25	
Sinusoidal	IEC60255-21-1	Class 1
Vibration:	1000233-21-1	CIUSS 1
Shock & Bump:	IEC60255-21-2	Class 1
Siesmic:	IEC60255-21-3	Class 2
Power magnetic	IEC61000-4-8	Level 5
Immunity:	15001000 / 0	Laural A
Pulse Magnetic	IEC61000-4-9	Level 4
Immunity: Damped Magnetic	IEC61000-4-10	Level 4
Immunity:	IEC01000-4-10	Level 4
Voltage Dip &	IEC61000-4-11	0 /0 70 80%
interruption:	10001000-4-11	0, 40, 70, 80% dips, 250/
interruption.		300 cycle
		interrupts
Damped	IEC61000-4-12	2.5KV CM, 1KV
Oscillatory:		DM
Conducted RF	IEC61000-4-16	Level 4
Immunity 0-150khz:		
Voltage Ripple:	IEC61000-4-17	15% ripple
Ingress Protection:	IEC60529	IP40 front ,
-		IP10 Back
Environmental	IEC60068-2-1	-40C 16 hrs
(Cold):	1500000 2 2	050 100
Environmental (Dry	IEC60068-2-2	85C 16hrs
heat): Relative Humidity	IEC60068-2-30	6day variant 2
Cyclic:	1200000-2-30	oudy variant 2
EFT:	IEEE®/ANSI C37.90.1	4KV, 2.5Khz
Damped Oscillatrony:	IEEE/ANSI C37.90.1	2.5KV,1Mhz
Oscillatrory: RF Immunity:	IEEE/ANSIC37.90.2	20V/m
in infiniturity.	ILLL/ MINJICJ / .JU.Z	80-1Ghz
ESD:	IEEE/ANSIC37.90.3	8KV CD/ 15KV
		AD
	UL508	e83849 NKCR
Safety:	UL C22.2-14	e83849 NKCR7
*	UL1053	e83849 NKCR

# **Technical Specifications (Continued)**

CERTIFICATION	
CE: North America:	Low voltage directive EN60255-5 / EN60255-27 / EN61010-1 EMC Directive EN60255-26/ EN50263, EN61000-6-2, UL508 cULus UL1053, C22.2.No 14
ISO:	Manufactured under a registered quality program ISO9001

OPERATING ENVIRO	NMI
Ambient operating	-4
temperature:	
Ambient storage /	-4
shipping	
temperature:	
Humidity:	Op
	CC
	IEC
Altitude:	20
Pollution dearee	11

Pollution degree: Overvoltage category: Ingress Protection:

 IRONMENT

 ing
 -40°C to +60°C [-40°F to +140°F]

 e
 -40°C to +85°C [-40°F to +185°F]

 Operating up to 95% (non condensing) @ 55C (As per IEC60068-2-30 Variant 2, 6days) 2000m (max)

 EI


 III

IP40 Front , IP10 back

DIMENSIONS Size: Weight:

Refer to Dimensions Chapter 4.1 kg [9.0 lb]

# Ordering

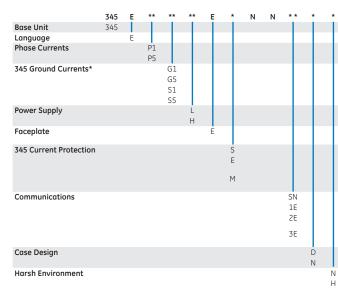

#### Ordering Notes:

•

\* 1) G1/G5 and S1/S5 must match corresponding P1/P5 - there cannot be 5A and 1A mixing

### Accessories for the 345

- Multilink Ethernet Switch
- ML2400-F-HI-HI-A2-A2-A6-G1
- Viewpoint Engineer
- VPE-1
- Viewpoint Maintenance VPM-1
- Viewpoint Monitoring IEC 61850 VP-1-61850

### Visit GEMultilin.com/345 to:

- View Guideform specifications
- Download the instruction manual
- Review applications notes and support documents
- Buy a 345 online
- View the 3 Series Family brochure

Description
Base Unit
English
1A three phase current inputs
5A three phase current inputs
1A ground current input
5A ground current input
1A sensitive ground current input
5A sensitive ground current input 24 - 48 Vdc
110 - 250 V dc/110 - 230 Vac
Standard faceplate (LCD, full menu, actual values and setpoints) with 10 Inputs, 7 Outputs (2
Form A, 5 Form C)
Standard configuration - 87T, 87T-50, 51P(1), 51G(1), 50P(1), 50G(1), 51N(1), 50N(1)
Extended configuration - 87T, 87T-50, 51P(2), 51G(2), 50P(2), 50G(2), 51N(2), 50(2), 50BF(1), RGF(1), 49P
Advanced configuration - 87T, 87T-50, 51P(2), 51G(2), 50P(2), 50G(2), 50BF(2), 49P, 51N(2), 50N(2), 51_2 (2), RGF(2)
Standard :Front USB, Rear RS485 : Modbus RTU, DNP3.0, IEC60870-5-103
Standard + Ethernet (Copper & Fiber - MTRJ) MODBUS TCP/IP, DNP3.0, IEC 60870-5-104
Standard + Ethernet (Copper & Fiber - MTRJ) MODBUS TCP/IP, DNP3.0, IEC 60870-5-104, IEC
61850 GOOSE Standard + Ethernet (Copper & Fiber - MTRJ) MODBUS TCP/IP, DNP3.0, IEC 60870-5-104, IEC 61850
Draw-out design
Non Draw-out design
None

Harsh Environment Conformal Coating

### **GE Digital Energy**

650 Markland St. Markham, ON Canada L6C 0M1

Toll Free (NA Only): 1-800-547-8629 Tel: 905-927-7070 Fax: 905-927-5098

gedigitalenergy@ge.com

## GEDigitalEnergy.com

IEC is a registered trademark of Commission Electrotechnique Internationale. ANSI is a registered trademark of American National Standards Institute, Incorporated. IEEE is a registered trademark of the Institute of Electrical Electronics Engineers, Inc. GE, the GE monogram, Multilin and EnerVista are trademarks of the General Electric Company.

GE reserves the right to make changes to specifications of products described at any time without notice and without obligation to notify any person of such changes.

Copyright 2013, General Electric Company. All Rights Reserved.



